


Drainage Notes:

1. Flow lines on concrete surface shall have a minimum 1% slope and flow lines on landscape surface shall be a minimum 2% slope.
2. Concrete and Landscape areas adjacent to the building shall be at a 2% min slope and max 20% slope draining away from the building. (See Detail)
3. Sheet flow on concrete surface shall have a minimum slope of 1% and sheet flow on landscape surface shall have a minimum slope of 2%.
4. The flow line shall be located at a minimum 3' from the side of the building and 5' min. from the back of the building.
5. Draining onto adjacent property is not permitted.

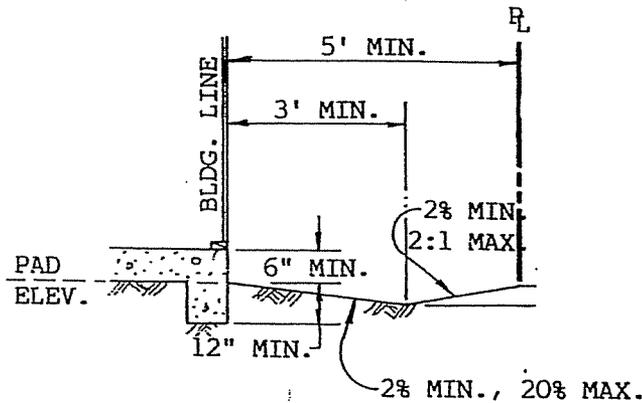

Additional Erosion Control Notes:

1. In case of emergency call \_\_\_\_\_ at \_\_\_\_\_
2. The inspector reserves the right to change/add to the approved erosion control plan as needed
3. Protect the nearest downstream street curb inlet with gravel bags and hardware/filter cloth.
4. Grate type yard catch basins must be encircled with gravel bags having (1) one layer for each foot of width of catch basin.

